



# Pipe Restainers series 9000

9000C Restainers for AWWA CI OD C900/C909 PVC/PVCO Pipe with MJ or Push-On Fittings

## NEW NAME; SAME GREAT PERFORMANCE

The 9000 was introduced in Canada first and has been well received. The product's better performance on AWWA C900 and C909 has resulted in this product becoming the company's new standard offering in 4" through 12". As the 1000 family is a widely recognized brand of pipe restraint, the 9000 has been renamed 1000G2. The 1000G2 is replacing the 1000C in sizes 12" and down for use on CI OD pipe.



## INFORMATION

PVC Restainers for restraining mechanical joint or push-on fittings with PVC pipe. These restraints work in any type of soil for a guaranteed joint restraint with rated pressure as listed below.

PVC restraints can be installed on new or existing systems, totally eliminating the use of thrust blocks. These restraints have internal serrations that lock onto the pipe and give 360° contact and support the pipe wall. Restraint devices may be used with any type of PVC piping system.

**Rated to the New, Higher Pressure Classes in Latest Editions of AWWA C900 and C909**

## FEATURES & ADVANTAGES

- 360° contact, no pipe distortion or point loading and supports the wall of the pipe
- Made of Ductile Iron - ASTM Grade A536, Grade 65-45-12
- Restainers work with Mechanical Joint or Push-On Fittings.
- For use on 4" - 12" C900 PVC and C909 PVCO Pipe.
- All restraints are machined to exact tolerances.
- The safety factor is twice (2:1) the maximum pressure rating listed on next page.
- Can be installed outside the trench, to ease installation
- Maintains full deflection on Mechanical Joint and Push-On Fittings
- T-Bolts/Hex Nuts: low alloy steel per ANSI/AWWA C111/A21.11
- Clamping Bolts: SAE J429 Grade 5
- Series 9000C is approved by Factory Mutual Research in sizes 4" - 12" for use on C900 DR18 pipe for 150 PSI.
- Standard color is Graphite Black (RAL 9011).



9000C with MJ Fitting

## SAMPLE SPECIFICATIONS

*PVC restraint devices shall be manufactured of high strength ductile iron in accordance to ASTM A536 Grade 65-45-12 for all sizes. Internal serrations will be machined to provide exact tolerances to provide 360° contact and support of the pipe wall. PVC Restraint devices shall have a safety factor of 2:1 over the pipe pressure rating.*




STAR® PIPE PRODUCTS



# Pipe Restrainers series 9000

9000C Restrainers for AWWA CI OD C900/C909 PVC/PVCO Pipe with MJ or Push-On Fittings

## TECHNICAL INFORMATION

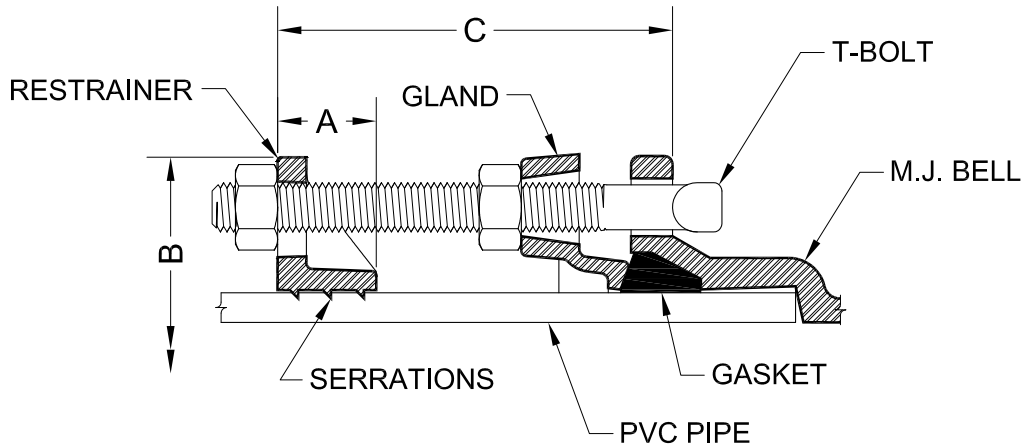

4" - 12" Sizes

### PIPE RESTRAINERS 9000 SPECIFICATIONS\*

| NOM. SIZE | PVC PIPE WITH DUCTILE IRON PIPE O.D. STYLE 9000C | A    | B APPROX. | C MAX. | RESTRAINT BOLTS (T-BOLTS) |         | CLAMPING BOLTS |             | APPROX WT. (LBS) |
|-----------|--|------|-----------|--------|---------------------------|---------|----------------|-------------|------------------|
|           |  |      |           |        | QTY                       | SIZE    | QTY            | SIZE        |                  |
| ** 4      | 4.80   | 1.44 | 9.32      | 6.00   | 2                         | 3/4 x 7 | 2              | 5/8 x 3 1/2 | 7.24             |
| ** 6      | 6.90   | 1.50 | 11.14     | 6.00   | 2                         | 3/4 x 7 | 2              | 5/8 x 3 1/2 | 8.10             |
| 8         | 9.05   | 2.00 | 14.76     | 8.00   | 2                         | 3/4 x 9 | 2              | 3/4 x 4     | 14.92            |
| 10        | 11.10  | 2.38 | 17.26     | 8.00   | 4                         | 3/4 x 9 | 2              | 7/8 x 5     | 26.49            |
| 12        | 13.20  | 2.38 | 20.00     | 8.00   | 4                         | 3/4 x 9 | 2              | 7/8 x 5     | 30.67            |

\* All dimensions in inches except where indicated.

\*\* Contact Star for price and availability.

### MAXIMUM WORKING PRESSURE RATING WITH OCCASSIONAL & RECURRING SURGES

| NOM. SIZE (IN) | C900 |      |      | C909   |
|----------------|------|------|------|--------|
|                | DR14 | DR18 | DR25 | PC 235 |
| 4              | 305  | 235  | 165  | 235    |
| 6              | 305  | 235  | 165  | 235    |
| 8              | 305  | 235  | 165  | 235    |
| 10             | 305  | 235  | 165  | 235    |
| 12             | 305  | 235  | 165  | 235    |





# Pipe Restrainers series 9000


9000C Restrainers for AWWA CI OD C900/C909 PVC/PVCO and Ductile Iron Pipe with MJ or Push-On Fittings

## INSTALLATION INSTRUCTIONS (SERIES 9000 4"-12")



STEP 1

To ensure the rubber gasket will seal effectively, clean and remove all loose materials from the mating surfaces. If the pipe being installed is PVC, verify that the end going into the MJ bell is square cut. If not, remove all but 1/8" of the bevel and debur it. Insert and completely home the pipe into the MJ fitting bell. Then insert one of the long T-bolts provided through one of the holes as shown. Mark a line 1 1/4" away from the end of the T-bolt and towards the MJ bell as shown.

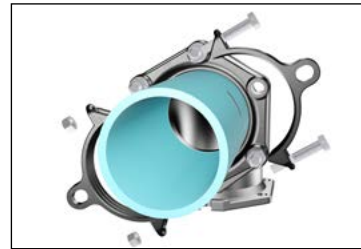


STEP 2

Assemble the MJ joint using the gland, gasket and T-bolts per the AWWA standards and as modified for AWWA C909 pipe in these guidelines. (Note that the long T-bolts are installed later.) Next, assemble the restrainer on the pipe so that it is even with the line marked on the pipe in Step No. 1. Make sure that the open ends of the restrainer ears are toward the MJ fitting bell. Also ensure that the holes in the restrainer ears line up with the bolt holes of the MJ gland. Evenly tighten the restrainer clamping bolts to the recommended torque shown below.



STEP 3

Insert one of the long T-bolts provided, installing one nut each between the gland and the restrainer as shown. Follow the same procedure for the remaining long T-bolts. Tighten nuts against the MJ gland per the AWWA standards and as modified for AWWA C909 pipe in these guidelines. (See table for T-bolt/nut torque details.)

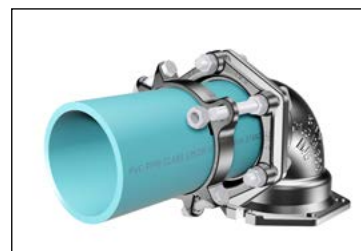

STEP 4

Snug tighten the second nut on each long T-Bolt against the restrainer as shown. Washers are provided for sizes 8" to 12".

**Caution: Do not over-tighten the restraining nuts. Turn nut to hand tight plus half turn.**

| T-HEAD BOLT & NUT DETAILS |                |                          |         |
|---------------------------|----------------|--------------------------|---------|
| PIPE SIZE (IN)            | BOLT SIZE (IN) | RANGE OF TORQUE (FT-LBS) |         |
|                           |                | C900/DI PIPE             | C909    |
| 4-12                      | 3/4            | 75 - 90                  | 55 - 65 |

| RECOMMENDED TORQUE (CLAMPING BOLTS) |                    |                  |
|-------------------------------------|--------------------|------------------|
| PIPE SIZE (IN)                      | C900/C909 (FT-LBS) | DI PIPE (FT-LBS) |
| 4-10                                | 100                | 110              |
| 12                                  | 130                | 130              |



STAR® PIPE PRODUCTS





# Pipe Restrainers series 9100

9100C Bell Restrainers for AWWA CI OD C900/C909 PVC/PVCO Pipe Joints

## NEW NAME; SAME GREAT PERFORMANCE

The 9100 was introduced in Canada first and has been well received. The product's better performance on AWWA C900 and C909 has resulted in this product becoming the company's new standard offering in 4" through 12". As the 1100 family is a widely recognized brand of pipe restraint, the 9100 has been renamed 1100G2. The 1100G2 is replacing the 1100C in sizes 12" and down for use on CI OD pipe.



Series 9100C for C900 PVC/C909 PVCO Pipe

## INFORMATION

PVC Restrainers for restraining PVC pipe bell joints. These restraints work in any type of soil for a guaranteed joint restraint with rated pressure as listed below.

PVC restrainers can be installed on new or existing systems, totally eliminating the use of thrust blocks. These restrainers have internal serrations that lock onto the pipe and give 360° contact and support the pipe wall. Restraint devices may be used with any type of PVC piping system.

**Rated to the New, Higher Pressure Classes in Latest Editions of AWWA C900 and C909\***

## FEATURES & ADVANTAGES

- 360° contact, no pipe distortion or point loading
- Made of Ductile Iron - ASTM Grade 536, Grade 65-45-12
- Restrainers work with Push-On Pipe Bells.
- For use on 4" - 12" C900 PVC and C909 PVCO pipe.
- All restrainers are machined to exact tolerances.
- The safety factor is twice (2:1) the maximum pressure rating listed on next page.
- Can be installed outside the trench, to ease installation
- Rods/Hex Nuts: low alloy steel per ANSI/AWWA C111/A21.11
- Clamping Bolts: SAE J429 Grade 5
- Series 9100C is approved by Factory Mutual Research in sizes 4"- 12" for use on C900 PVC DR18 for 150 PSI.
- Standard color is Graphite Black (RAL 9011).



Series 9100C

\* See table on next page.

## SAMPLE SPECIFICATIONS

*PVC restraint devices shall be manufactured of high strength ductile iron in accordance to ASTM A536 Grade 65-45-12 for all sizes. Internal serrations will be machined to provide exact tolerances to provide 360° contact and support of the pipe wall. PVC Restraint devices shall have a safety factor of 2:1 over the pressure rating.*




STAR® PIPE PRODUCTS



# Pipe Restrainers series 9100

9100C Bell Restrainers for AWWA CI OD C900/C909 PVC/PVCO Joints

## TECHNICAL INFORMATION

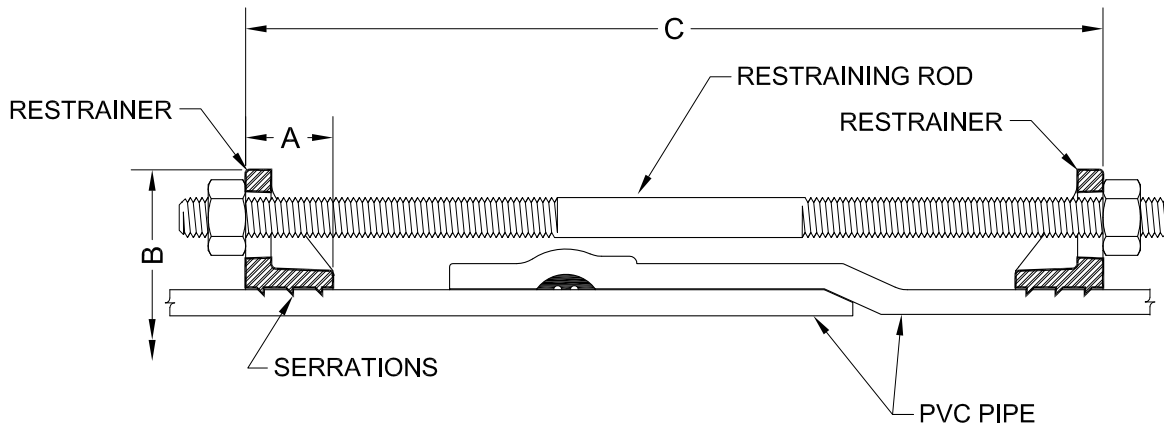

4" - 12" Sizes

### PIPE RESTRAINERS 9100 SPECIFICATIONS\*

| NOM. SIZE | PVC PIPE WITH DUCTILE IRON PIPE O.D. STYLE 9100C<br>O.D. | A    | B APPROX. | C MAX. | RESTRAINT RODS |          | CLAMPING BOLTS |             | APPROX WT. (LBS) |
|-----------|--|------|-----------|--------|----------------|----------|----------------|-------------|------------------|
|           |  |      |           |        | QTY            | SIZE     | QTY            | SIZE        |                  |
| ** 4      | 4.80   | 1.44 | 9.32      | 15.00  | 2              | 3/4 x 17 | 4              | 5/8 x 3 1/2 | 12.63            |
| ** 6      | 6.90   | 1.50 | 11.14     | 15.00  | 2              | 3/4 x 17 | 4              | 5/8 x 3 1/2 | 14.35            |
| 8         | 9.05   | 2.00 | 14.76     | 22.00  | 2              | 3/4 x 24 | 4              | 3/4 x 4     | 27.45            |
| 10        | 11.10  | 2.38 | 17.26     | 22.00  | 4              | 3/4 x 24 | 4              | 7/8 x 5     | 48.21            |
| 12        | 13.20  | 2.38 | 20.00     | 22.00  | 4              | 3/4 x 24 | 4              | 7/8 x 5     | 56.57            |

\* All dimensions in inches except where indicated.

\*\* Contact Star for price and availability.

### MAXIMUM WORKING PRESSURE RATING WITH OCCASSIONAL & RECURRING SURGES

| NOM. SIZE (IN) | C900 |      |      | C909   |
|----------------|------|------|------|--------|
|                | DR14 | DR18 | DR25 | PC 235 |
| 4              | 305  | 235  | 165  | 235    |
| 6              | 305  | 235  | 165  | 235    |
| 8              | 305  | 235  | 165  | 235    |
| 10             | 305  | 235  | 165  | 235    |
| 12             | 305  | 235  | 165  | 235    |

STAR® PIPE PRODUCTS





# Pipe Restrainers series 9100

9100C Bell Restrainers for AWWA CI OD C900/C909 PVC/PVCO and Ductile Iron Pipe Joints

## INSTALLATION INSTRUCTIONS (SERIES 9100 4"-12")



STEP 1

Assemble the spigot end of first pipe into the second pipe's bell per the pipe manufacturer's instructions.



STEP 2

Assemble one restraint behind the bell of pipe. Make sure that the open end of the restraint ears are toward the joint. Evenly tighten the restraint clamping bolts to the recommended torque, ensuring the gap between pads on both sides remain even. Use one of the restraint rods as a guide to position the restraint on spigot end. Mark a reference line such that the restraint rod ends extend past each nut approximately 1/2".

**NOTE: The length of the PVC pipe bell varies from manufacturer to manufacturer. Please contact Star Pipe Products if rod length is too short.**



STEP 3

Assemble the second restraint on the spigot end of pipe. Make sure that the open end of the restraint ears are toward the joint. After aligning the second restraint with the first one, tighten the clamping bolts to recommended torque evenly such that the gap between pads on both sides remain even.



STEP 4

Insert the restraining rods through the restraint ears. Snug tighten all nuts such that rods stick out approximately 0.50" past the nut on each end. Washers are provided for size 8"-12".

**Caution: Do not over - tighten restraining nuts. Turn nut to hand tight plus half turn.**

| RECOMMENDED TORQUE (CLAMPING BOLTS) |                    |                  |
|-------------------------------------|--------------------|------------------|
| PIPE SIZE (IN)                      | C900/C909 (FT-LBS) | DI PIPE (FT-LBS) |
| 4-10                                | 100                | 110              |
| 12                                  | 130                | 130              |

STAR® PIPE PRODUCTS










# Pipe Restrainers series 9000C & 9100C

9000C & 9100C For Use On Ductile Iron Pipe

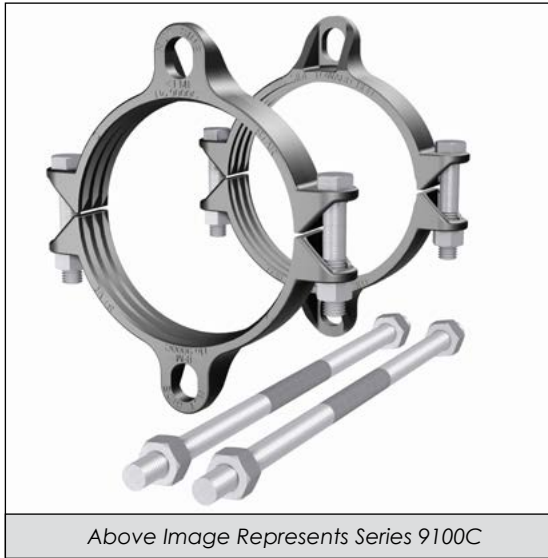


Above Image Represents Series 9100C

## INFORMATION


Pipe restrainers for restraining ductile iron pipe with mechanical joint or push-on fittings and DIP bell joints.

Pipe restrainers can be installed on new or existing systems, totally eliminating the use of thrust blocks. These restrainers have internal serrations that lock onto the pipe and give 360° contact and support the pipe wall.

## For Use on Ductile Iron Pipe

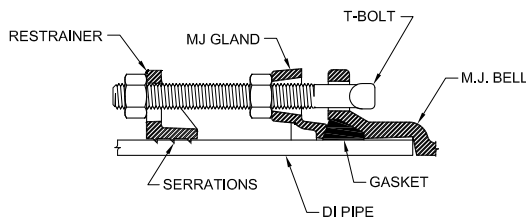

Series 9000C (4" - 12")

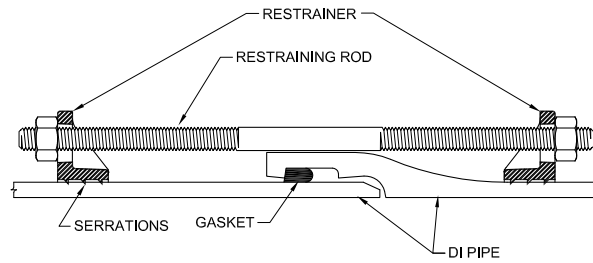

Series 9100C (4" - 12")

## FEATURES & ADVANTAGES

- Castings made of Ductile Iron - ASTM A536, Grade 65-45-12
- Restrainers work with Mechanical Joint or Push-On Fittings and with Ductile Iron Pipe manufactured per ANSI/AWWA C-151/A21.51 & AWWA C150/A21.50
- All restrainers are machined to exact tolerances
- The safety factor is twice (2:1) the maximum pressure rating listed below.
- Maintains full deflection on Mechanical Joint and Push-On Fittings
- T-Bolts/Rods/Hex Nuts: Low alloy steel per ASTM/AWWA C111/A21.11
- Clamping Bolts: SAE J429 Grade 5

### Notes:

- *Not recommended for installations on machined end pipe or fittings*
- *Installation requires clamp bolt torque values be applied as indicated above.*
- *Installation and testing to be in accordance with the latest version of ANSI/AWWA C600*
- *For higher pressure requirements, please contact Star® Pipe Products*
- *Pipe hardness not to exceed 230 BHN.*

| NOMINAL SIZE | MAXIMUM PRESSURE RATINGS (PSI) | RECOMMENDED CLAMP BOLT TORQUE (FT-LBS) |
|--------------|--------------------------------|--|
| 4" - 10"     | 250                            | 110                                    |
| 12"          | 200                            | 130                                    |

### SAMPLE SPECIFICATIONS

Pipe restraining devices shall be manufactured of high strength ductile iron in accordance to ASTM A536 Grade 65-45-12 for all sizes. Internal serrations will be machined to provide exact tolerance to provide 360° contact and support of the pipe wall. Pipe restraining devices shall have a safety factor of 2:1 over the pressure rating.



STAR® PIPE PRODUCTS





# Pipe Restainers series 9200

9200C Restainers for C900/C909 PVC/PVCO Pipe and PVC Pressure Fittings w/Ductile Iron Pipe OD

## NEW NAME; SAME GREAT PERFORMANCE

The 9200 was introduced in Canada first and has been well received. The product's better performance on AWWA C900 and C909 has resulted in this product becoming the company's new standard offering in 4" through 12". As the 1200 family is a widely recognized brand of pipe restraint, the 9200 has been renamed 1200G2. The 1200G2 is replacing the 1200C in sizes 12" and down for use on CI OD pipe.



## INFORMATION

PVC Restainers are for restraining bell joints between AWWA C900/C909 PVC/PVCO pipe and PVC pressure fittings. The PVC pressure fitting may be PC235 psi molded AWWA C907 PVC pressure fittings or PR 235 psi fabricated PVC pressure fittings.

PVC restrainers can be installed on new or existing systems, totally eliminating the use of thrust blocks. These restrainers have internal serrations that lock onto the pipe and give 360° contact and support the pipe wall.

**Rated to the New, Higher Pressure Classes in Latest Editions of AWWA C900 and C909\***

## FEATURES & ADVANTAGES

- 360° contact, no pipe distortion or point loading
- Made of Ductile Iron - ASTM Grade 536, Grade 65-45-12
- Restainers work with either
  - PC235 psi molded AWWA C907 PVC pressure fittings or
  - PR235 psi fabricated PVC pressure fittings.
- All restrainers are machined to exact tolerances.
- The safety factor is twice (2:1) the maximum pressure rating listed on next page.
- Supports wall of pipe with 360 degree contact
- Can be installed outside the trench, to ease installation
- T-Bolts/Rods/Hex Nuts: low alloy steel per ANSI/AWWA C111/A21.11
- Clamping Bolts: SAE J429 Grade5
- Standard gland color is Graphite Black (RAL 9011).



9200C Restainer

\* See table on next page.

## SAMPLE SPECIFICATIONS

*PVC restraint devices shall be manufactured of high strength ductile iron in accordance to ASTM A536 Grade 65-45-12 for all sizes. Internal serrations will be machined to provide exact tolerances to provide 360° contact and support of the pipe wall. PVC Restraint devices shall have a safety factor of 2:1 over the pressure rating.*

JRCAT15.01



® REGISTERED TRADEMARK OF STAR PIPE PRODUCTS

STAR® PIPE PRODUCTS  
HOUSTON CORPORATE | TOLL FREE 1-800-999-3009 | FAX 281-558-9000  
www.starpipeproducts.com


STAR® PIPE PRODUCTS



# Pipe Restrainers series 9200

9200C Restrainers for C900/C909 PVC/PVCO Pipe and PVC Pressure Fittings w/Ductile Iron Pipe OD

## TECHNICAL INFORMATION

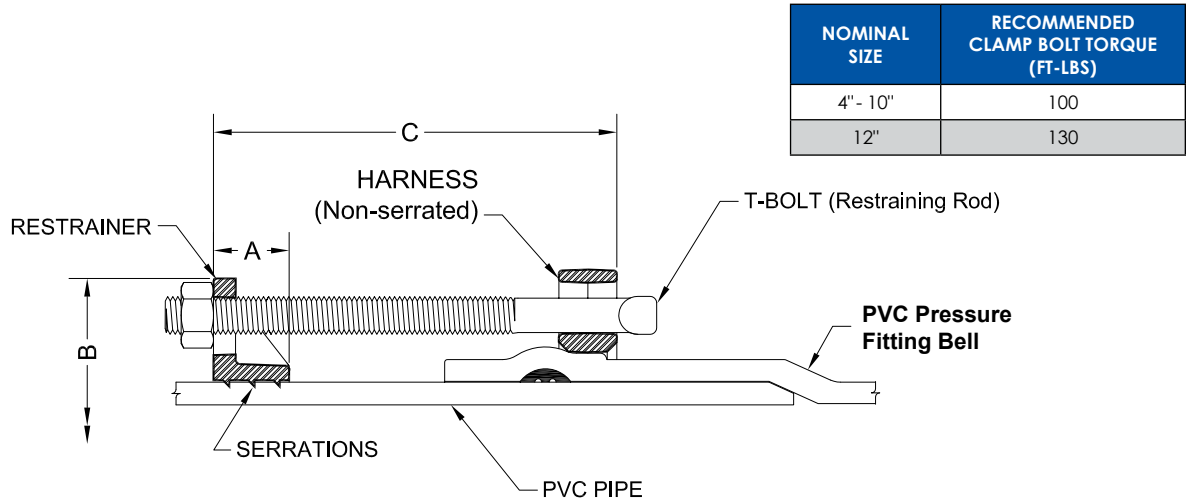

| NOMINAL SIZE | RECOMMENDED CLAMP BOLT TORQUE (FT-LBS) |
|--------------|--|
| 4" - 10"     | 100                                    |
| 12"          | 130                                    |

4" - 12" SIZES

### PIPE RESTRAINERS 9200 SPECIFICATIONS\*

| NOM. SIZE <sup>1</sup> | PVC PIPE WITH DUCTILE IRON PIPE O.D. STYLE 9200C<br>O.D. | A    | B APPROX. | C MAX. | RESTRAINT BOLTS/RODS |          | CLAMPING BOLTS |             | APPROX WT. (LBS) |
|------------------------|--|------|-----------|--------|----------------------|----------|----------------|-------------|------------------|
|                        |  |      |           |        | QTY                  | SIZE     | QTY            | SIZE        |                  |
| ** 4                   | 4.80   | 1.44 | 9.32      | 8.00   | 2                    | 3/4 x 9  | 4              | 5/8 x 3-1/2 | 13.58            |
| ** 6                   | 6.90   | 1.50 | 11.14     | 8.00   | 2                    | 3/4 x 9  | 4              | 5/8 x 3-1/2 | 16.84            |
| 8                      | 9.05   | 2.00 | 14.76     | 11.00  | 2                    | 3/4 x 12 | 4              | 3/4 x 4     | 28.28            |
| 10                     | 11.10  | 2.38 | 17.26     | 11.00  | 4                    | 3/4 x 12 | 4              | 7/8 x 5     | 43.10            |
| 12                     | 13.20  | 2.38 | 20.00     | 11.00  | 4                    | 3/4 x 12 | 4              | 7/8 x 5     | 54.38            |

\* All dimensions in inches except where indicated.

\*\* Contact Star for price and availability

| NOM. SIZE (IN) | C900  |      |      | C909   |
|----------------|-------|------|------|--------|
|                | DR14+ | DR18 | DR25 | PC 235 |
| 4              | 235   | 235  | 165  | 235    |
| 6              | 235   | 235  | 165  | 235    |
| 8              | 235   | 235  | 165  | 235    |
| 10             | 235   | 235  | 165  | 235    |
| 12             | 235   | 235  | 165  | 175    |

+ Derated due to rating of PVC pressure fitting.

STAR® PIPE PRODUCTS





# Pipe Restrainers series 9200


9200C Restrainers for C900/C909 PVC/PVCO Pipe and PVC Pressure Fittings w/Ductile Iron Pipe OD

## INSTALLATION INSTRUCTIONS (SERIES 9200 4"-12")




STEP 1

Insert the pipe into fitting bell per fitting manufacturer's instructions.

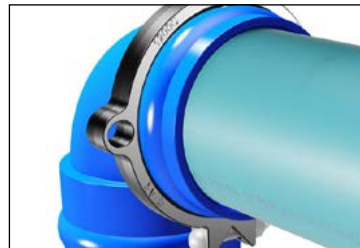


STEP 2

Assemble harness behind the bell of fitting using clamping bolts and nuts supplied. Evenly tighten to recommended torque.

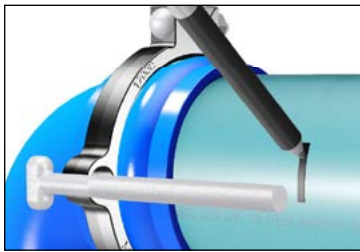


STEP 3

Using one of the T-bolts / rods (provided) mark a reference line such that the T-bolt / rod end extends past the nut by approximately 1/2".

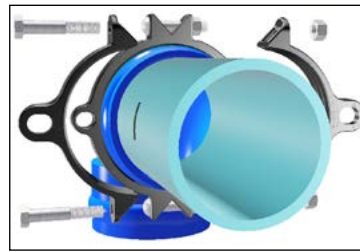

STEP 4

**Make sure the open end of the restrainer ears are toward the joint.** Tighten serrated restrainer clamp bolts evenly to recommended torque making sure the gap between bolt pads on both sides remain even.

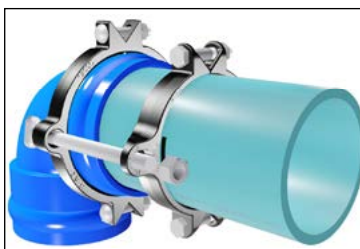

STEP 5

Insert the T-bolts / rods (provided) through restrainers as shown. For size 8" to 12", place a washer (provided) on each end of rod behind the restrainer ears. Snug tighten the nuts so that the spigot end is secured into the bell end.

**Caution: Do not over-tighten restraining nuts. Turn nut to hand fight plus half turn.**

| RECOMMENDED CLAMP BOLT TORQUE |                    |
|-------------------------------|--------------------|
| PIPE SIZE (IN)                | C900/C909 (FT-LBS) |
| 4-10                          | 100                |
| 12                            | 130                |

STAR® PIPE PRODUCTS

